

Zone Output Module (Master)

ECS-6216P



OVERVIEW

The ECS-6216P is the main primary output zone module that allows the addition of 16 output zones to the system 6000. Up to 160 outputs zone capacity is possible with the addition of up to 9 ECS-6216MS Slave units to the ECS-6216P. Each unit also offer an addition of 16CH GPI sensor input for messaging, event and scenario triggering.

FEATURES

- 8 Audio Bus input
- 16 output zones
- 16CH GPI sensor input
- RS-485 communication
- Front panel manual control


SPECIFICATIONS

		ECS-6216P
Priority		Emergency>Timer>Remote 1>Remote 2>Main
Channel		16CH
Communications Protocol	LINK IN/OUT	RS-485 (Maximum: 1km/3,280 feet)
	RM INPUT (RM1, 2)	RS-422 (Maximum: 1km/3,280 feet)
SOURCE		RS-232 (Maximum: 12m/40 feet)
Fire Sensor		Dry Contact
Operating Temperature		-10°C ~ +40°C/14°F~104°F
Power Source		DC 24V, 900mA
Weight (Set)		4.3kg/9.5lbs
Dimensions (Set)		482(W)x88(H)x280(D)mm/19(W)x3.5(H)x11(D)in

* Specifications and design are subject to change without notice.

ZONE OUTPUT MODULE (MASTER)


Zone Output Module (Master) ECS-6216P

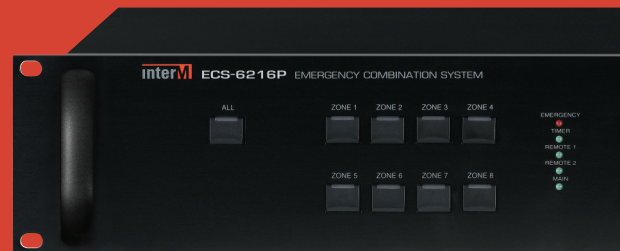


APPLICATION

Our technology can be found in schools, hospitals, malls, campus, transportation, correctional facilities and a variety of commercial and industrial applications.

- * Education facilities
(Elementary / high school / College /University / Training Institute, etc)
- * Commercial establishments
(Department stores, Shopping centers, multiplex cinemas, hospitals, etc.)
- * Public facilities
(Government offices, transportation, stations, terminal, exhibition hall, factory, resorts, etc.)

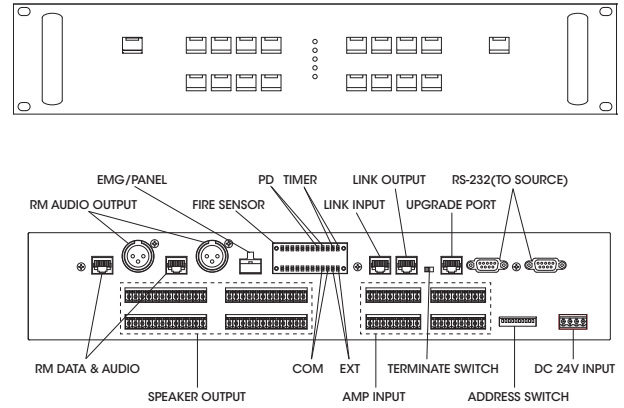

BLOCK DIAGRAM

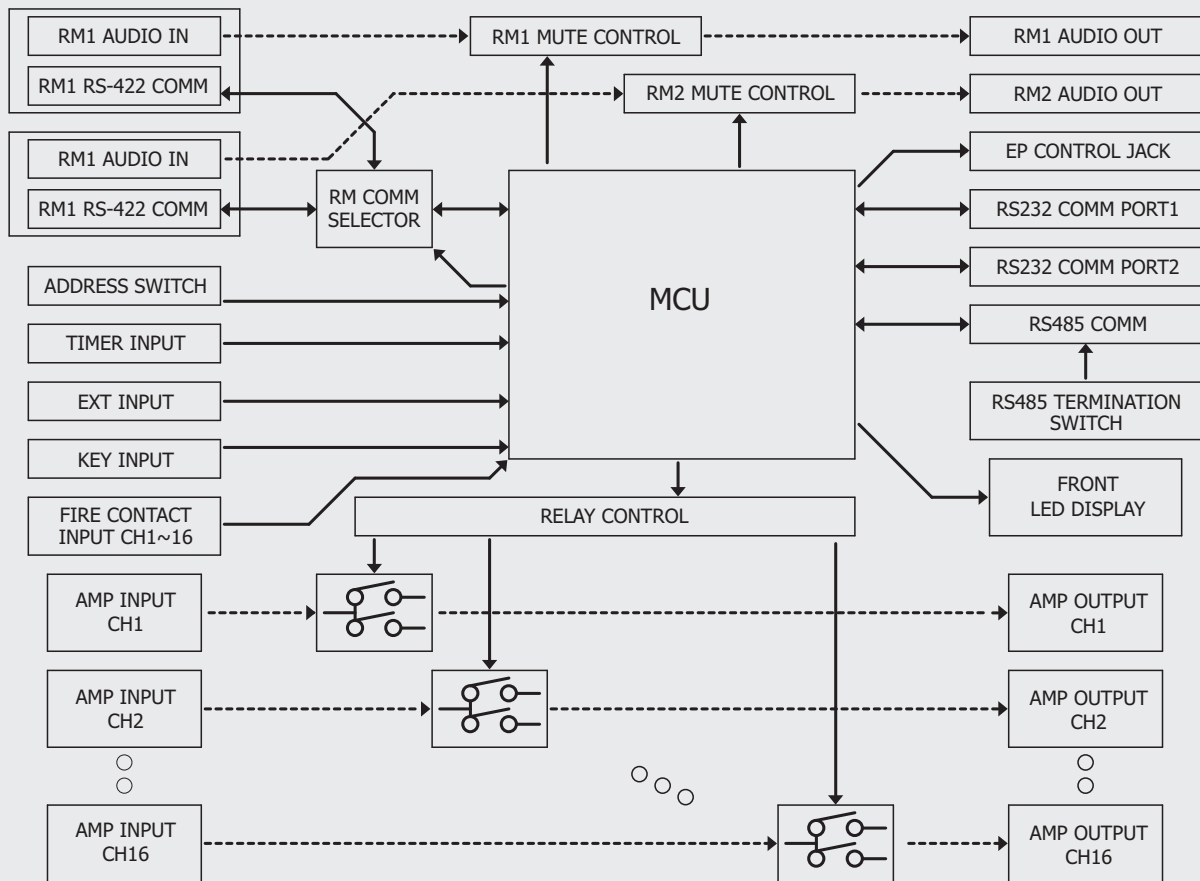

Inter-M Corporation

- Office : 653-5 BANGHAK-DONG, DOBONG-GU, SEOUL, KOREA
 - Tel : +82-2-2289-8140~8, Fax : +82-2-2289-8149
 - Home page: <http://www.inter-m.com>, E-mail: overseas@inter-m.com

Inter-M Corporation (USA)

- Office : 14730 E. FIRESTONE BLVD #312 LA MIRADA, CA 90638
 - Tel : +1-714-523-1870, Fax : +1-714-523-1882
 - Home Page : <http://www.inter-m.net>, E-mail : info@inter-m.net